


INSTALLATION INSTRUCTIONS

Series 825YD, 826YD Reduced Pressure Zone Assemblies Reduced Pressure Detector Assemblies Sizes: 2½" – 10" (65 – 250mm)

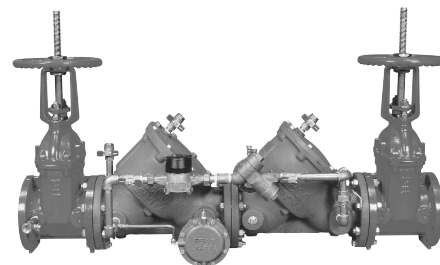

826YD

Installation Instructions

1. Consult local codes for specific installation requirements and restrictions applicable to your area. It is recommended that system supply pressure be at least 20psi (133kPa).
2. These instructions apply to series 825YD, and 826YD size 2½" to 10" (65-250mm) only. The valves may be installed only in the horizontal orientation as shown.
3. The valve assembly must be installed where it is accessible for periodic testing and maintenance. Clearances shown in the installation views apply to exterior, interior and pit/vault installations and are only recommendations. These minimums do not apply to removable protective enclosures. Refer to local codes for actual requirements in your area.
4. PRIOR TO INSTALLING THE VALVE INTO THE LINE, FLUSH THE SUPPLY LINE OF ALL FOREIGN MATERIAL. Failure to flush the supply line may cause the check valves to become fouled and require disassembly and cleaning.
5. DO NOT LIFT THE ASSEMBLY BY CONNECTING TO THE GATE VALVE HANDWHEELS OR STEMS.
6. After installation SLOWLY fill the assembly with water and bleed air from the body using the #2, #3 and #4 test cocks. Test the valve assembly to ensure correct operation.


NOTE: All assemblies are tested at the factory for proper operation and leakage. If the valve does not pass the field test, it is most likely due to a fouled check valve. This is not covered by the factory warranty. The valve cover(s) must be removed and the check seats inspected and cleaned. Any damage or improper operation caused by pipeline debris or improper installation/start-up is not included in the factory warranty.

In case of a possible warranty claim, contact your local supplier or FEBCO Representative. DO NOT REMOVE THE VALVE ASSEMBLY FROM THE PIPELINE.

7. The assembly must be protected from freezing and excessive pressure increases. Pressure increases can be caused by thermal expansion or water hammer. These excessive pressure situations must be eliminated to protect the valve and system from possible damage.


Typical Installation

Figure 1

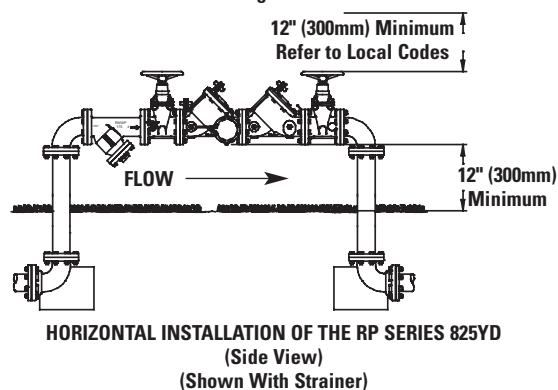

HORIZONTAL INSTALLATION OF THE RP SERIES 825YD
(Side View)
(Shown With Strainer)

Figure 2

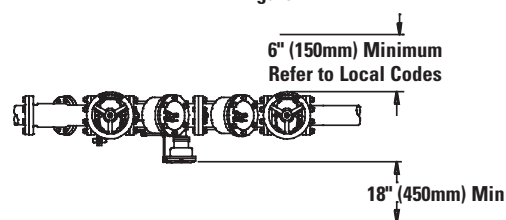

HORIZONTAL INSTALLATION OF THE RP SERIES 825YD
(Top View)
(Shown With Strainer)



Service and Maintenance

Service Procedure

Close the outlet shutoff valve, then close the inlet shutoff valve. Bleed residual pressure from the assembly by opening the #4, #3, and # 2 test cocks in this sequence.

General

1. Detailed maintenance manuals are available from your local FEBCO representative.
2. Rinse all parts with clean water prior to reassembly.
3. DO NOT USE ANY PIPE DOPE, OIL, GREASE OR SOLVENT ON ANY PARTS unless instructed to do so.
4. Do not force parts. Parts should fit together freely. Excess force may cause damage and render the assembly inoperable.
5. Carefully inspect seals and seating surfaces for debris or damage.
6. After servicing, repressurize the assembly and test to ensure proper operation.

Check Valve Disassembly

1. CAUTION: The cover retains the spring on 2½" - 3" (65 - 80mm) valve sizes. Remove the cover capscrews uniformly while holding the cover in place. Carefully reduce hand force on the cover to relieve spring compression.

The check module on the 4" - 10" (100 - 250mm) valve sizes retains the spring. Unscrew the capscrews uniformly to avoid binding the cover in the body bore. The spring will push the cover approximately ½" off the top of the body.

2. Lift the spring and check assembly 2½" - 3" (65 - 80mm) or check module 4" - 10" (100 - 250mm) from the body.
3. Inspect and clean debris from the disc and seat ring. Replace any damaged parts.
4. Use the reverse procedure to assemble. If necessary, apply a thin film of FDA/NSF approved grease to cover the O-ring. Install the capscrews and tighten in a uniform cross pattern.

Relief Valve Disassembly

1. Remove the capscrews holding the cover to the relief valve body, and remove the cover.
2. Remove the diaphragm and pull the internal assembly from the body. It may be helpful to push the internal assembly with your fingers through the discharge opening.
3. Inspect for debris, damage or fouling of the seat disc. Clean or replace the rubber disc as required.
4. Reposition the internal assembly and diaphragm into the body. Install the cover and cap screws.

Limited Warranty: FEBCO warrants each product to be free from defects in material and workmanship under normal usage for a period of one year from the date of original shipment. In the event of such defects within the warranty period, the Company will, at its option, replace or recondition the product without charge. This shall constitute the sole and exclusive remedy for breach of warranty, and the Company shall not be responsible for any incidental, special or consequential damages, including without limitation, lost profits or the cost of repairing or replacing other property which is damaged if this product does not work properly, other costs resulting from labor charges, delays, vandalism, negligence, fouling caused by foreign material, damage from adverse water conditions, chemical, or any other circumstances over which the Company has no control. This warranty shall be invalidated by any abuse, misuse, misapplication or improper installation of the product. **THIS WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, INCLUDING ANY IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE.** Any implied warranties that are imposed by law are limited in duration to one year.

Some States do not allow limitations on how long an implied warranty lasts, and some States do not allow the exclusion or limitation of incidental or consequential damages. Therefore the above limitations may not apply to you. This Limited Warranty gives you specific legal rights, and you may have other rights that vary from State to State. You should consult applicable state laws to determine your rights.



Field Test Procedure

FEBCO recommends the use of the appropriate test method presented in the ASSE Series 5000 manual that is consistent with your local codes.

Troubleshooting

PROBLEM	CAUSE	SOLUTION
1. Continuous relief valve discharge	a. Debris on check seating surfaces	Disassemble and clean
	b. Debris on relief valve seating surfaces	Disassemble and clean
2. Intermittent relief valve discharge	a. Inlet pressure fluctuations	Eliminate fluctuations
	b. Downstream pressure surges	Eliminate surges
3. Low flows passing through mainline valve (RPDA)	a. Mainline check fouled	Disassemble and clean
	b. Bypass line plugged	Disassemble and clean

Note: The gap drain is not designed to catch the maximum discharge possible from the relief valve. The installation of FEBCO air gap with the drain line terminating above a floor drain will handle any normal discharge or nuisance spitting through the relief valve. However, floor drain size may need to be designed to prevent water damage caused by a catastrophic failure condition. Do not reduce the size of the drain line from the air gap fitting.

CALIFORNIA PROPOSITION 65 WARNING

WARNING: This product contains chemicals known to the State of California to cause cancer and birth defects or other reproductive harm. (California law requires this warning to be given to customers in the State of California.)

For more information: www.watts.com/prop65